

**THE EFFECT OF THE HEAT FLUX ON THE SELF-IGNITION  
OF ORIENTED STRAND BOARD**

Siegfried HIRLE, Karol BALOG

SLOVAK UNIVERSITY OF TECHNOLOGY IN BRATISLAVA,  
FACULTY OF MATERIALS SCIENCE AND TECHNOLOGY IN TRNAVA,  
INSTITUTE OF INTEGRATED SAFETY,  
ULICA JÁNA BOTTU 2781/25, 917 24 TRNAVA, SLOVAK REPUBLIC  
e-mail: siegfried.hirle@stuba.sk, karol.balog@stuba.sk

**Abstract**

*This article deals with the initiation phase of flaming and smouldering burning of oriented strand board. The influence of heat flux on thermal degradation of OSB boards, time to ignition, heat release rate and mass loss rate using thermal analysis and vertical electrical radiation panel methods were studied. Significant information on the influence of the heat flux density and the thickness of the material on time to ignition was obtained.*

**Key words**

*thermal degradation, oriented strand board, thermal analysis, mass loss, heat release rate, time to ignition, heat flux*

**INTRODUCTION**

Fire technical characteristics of materials such as flash temperature, self-ignition temperature, critical temperature of thermo-oxidative degradation, the rate of weight loss during combustion of materials are not physical-chemical constants, and are strongly influenced by the test conditions and the history of the sample (1, 2, 3, 4).

Application of fire technical parameters in practice, when assessing the fire hazard, such as flash point, ignition temperature and self-ignition temperature, is very difficult. Based on these data, we cannot accurately determine the safety distance of flammable materials from ignition sources (5, 4, 6).

When real fire occurs mainly in closed spaces, heat flux plays a significant role in the spread of fire especially radiation. In order to determine the critical heat flux to ignite materials, a large-size and various lab tests were used (7, 8). Currently, the most commonly used test method is based on the principle of oxygen consumption during combustion, and the ignition source is electrically heated by conical heater (9, 10,11,12).

## MATERIALS AND METHODOLOGY OF EXPERIMENT

Samples of oriented strand board (OSB) from Kronospan Jihlava, marked OSB/3 SUPERFINISH ECO without any surface adjustments were chosen for the experiments (13). Dimension of the OSB boards samples were (165 x 165 x 8) mm, (165 x 165 x 14) mm and (165 x 165 x 25) mm. The selected board materials were conditioned at a room temperature of  $23\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$  and at a relative humidity of  $50 \pm 5\%$ .

### *Thermogravimetric analysis*

Samples testing was performed using the TG method regarding to (14) a Mettler Thermal Analyzer 3000 TA with a processor TC 10A and a TG 50 weights module in a dynamic atmosphere of air and flow rate of  $200\text{ ml}\cdot\text{min}^{-1}$  at a heating rate of  $10\text{ }^{\circ}\text{C min}^{-1}$ .

### *Differential Scanning Calorimetry*

The experiments were performed according to the standard EN ISO 11357: 2000 (15). Samples testing was performed using a Mettler Thermal Analyzer 3000 TA with a processor TC 10A and a DSC 20 measuring cell, in a dynamic atmosphere of air and flow rate of  $50\text{ ml}\cdot\text{min}^{-1}$  at a heat rate of  $10\text{ }^{\circ}\text{C min}^{-1}$ .

### *Method of Vertical Electrical Radiation Panel*

Vertical Electrical Radiation Panel (VERP) heated by electric coils was used in the experiment (Figure 1). This panel is heated by electrical coils and has dimensions of  $345\text{ mm} \times 515\text{ mm}$ .



*Fig. 1 Vertical Electrical Radiation Panel with radiometer*

Vertical electrical radiating panel is powered from the electric grid by 400V and the electric output of emitter can be controlled using three circuit breakers. The emitter output can be regulated in the range of 5 kW, 10 kW and 15 kW. Sample is attached to a vertical sample carrier.

### *Installing the Radiometer and Adjusting the Heat Flux Density for the Tests*

Heat flux density at a chosen distance was verified using the SBG01–200 radiometer regarding to ISO/DIS 14934-4 [10]. This radiometer is designed to measure the heat flux up to  $100 \text{ kW.m}^{-2}$ .


*Installation of the heat flux meter to specimen:* When a heat flux meter is installed into a specimen of OSB, holes are drilled in the specimen to accommodate the body of the heat flux meter. Table 1 shows the measured values of the heat flux for the chosen radiation output at a distance of 50 mm from the radiation source.

**Table 1** The output impact of the electrically heated radiation panel on heat flux level at a constant distance from the testing samples

Radiation panel output	5 kW		10 kW		15 kW	
Source distance [mm]	Output voltage [V]	Heat flux density [ $\text{kW.m}^{-2}$ ]	Output voltage [V]	Heat flux density [ $\text{kW.m}^{-2}$ ]	Output voltage [V]	Heat flux density [ $\text{kW.m}^{-2}$ ]
50	7.08	31	9.84	44	11.59	53


## RESULTS AND DISCUSSION

The first step of thermal degradation investigated by TG analysis starts at  $150 \text{ }^\circ\text{C}$  and ends at  $380 \text{ }^\circ\text{C}$ . In this interval, the biggest weight loss of samples was 66.72%. The second step of thermal degradation starts at  $380 \text{ }^\circ\text{C}$  and ends at  $486 \text{ }^\circ\text{C}$ . The thermal decomposition of OSB samples took place in two stages. In the first stage, the highest rate of decomposition of OSB was at  $326.7 \text{ }^\circ\text{C}$ , and in the second one at  $450.3 \text{ }^\circ\text{C}$  (Figure 2).

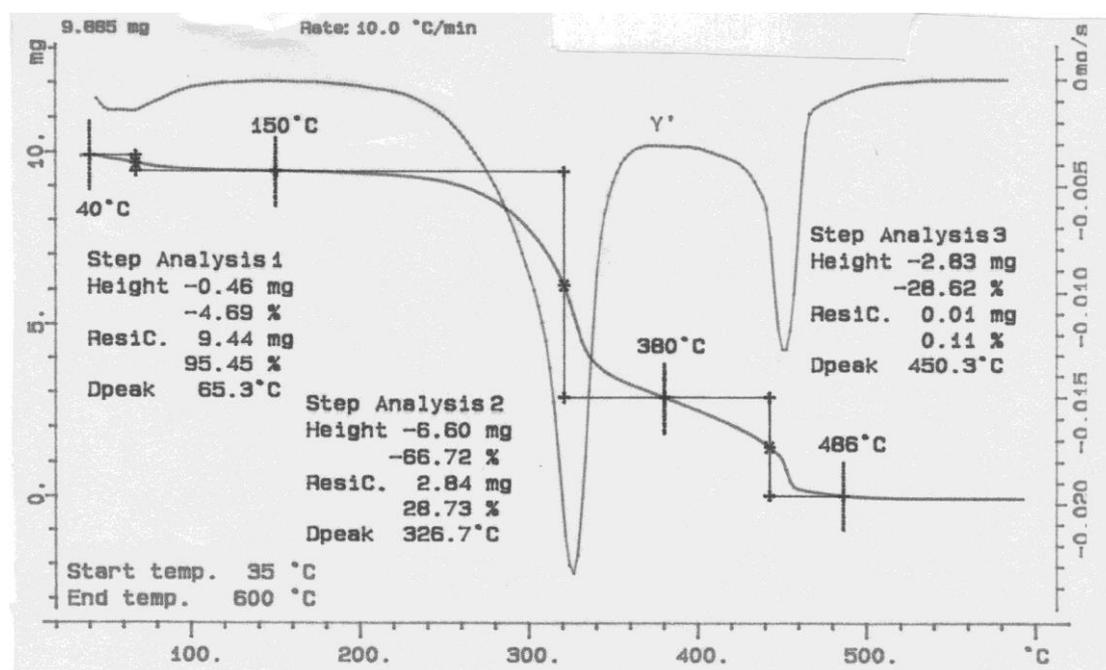

**Fig. 2** TG and DTG curves of OSB sample (heating rate  $10 \text{ }^\circ\text{C min}^{-1}$  and flow rate of air  $200 \text{ ml.min}^{-1}$ )

The results of DSC are shown in Figure 3. The exothermic decomposition of the OSB sample at heat rate of  $10\text{ }^{\circ}\text{C min}^{-1}$  occurred from  $220\text{ }^{\circ}\text{C}$  and continued up to  $560\text{ }^{\circ}\text{C}$ . The temperature at which occurred the maximum heat release rate of OSB sample in air was  $356\text{ }^{\circ}\text{C}$ . The second peak occurred at  $486.2\text{ }^{\circ}\text{C}$ . The change in reaction enthalpy of the OSB sample was  $9663.7\text{ J.g}^{-1}$  and  $\Delta H$  was  $51.701\text{ J}$ .

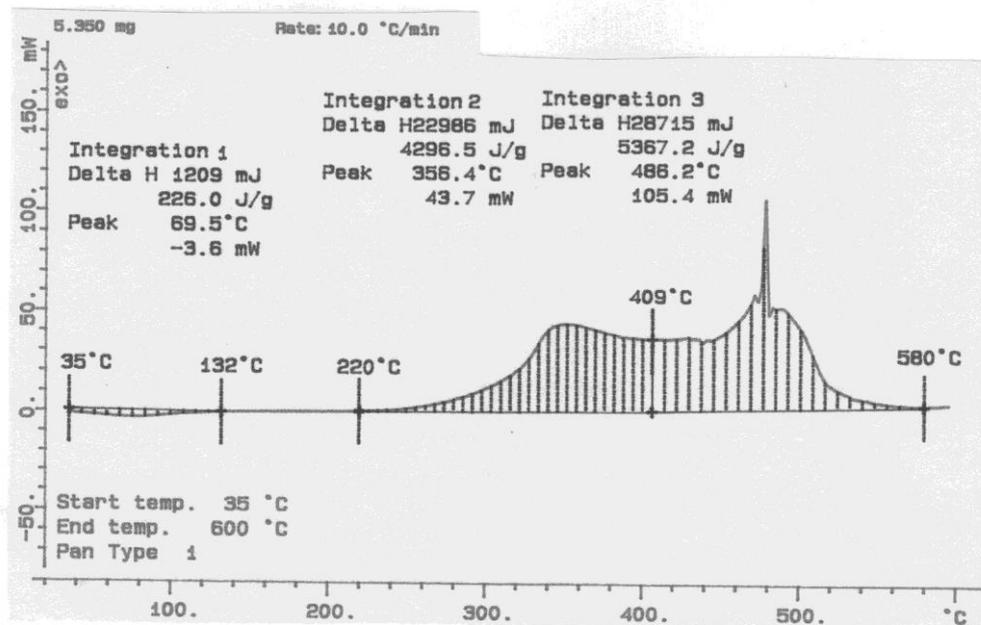

**Fig. 3** DSC curve of thermal decomposition of OSB in dynamic air flow


### ***The effect of the heat flux on the self-ignition of the OSB by using method of VERP***

For each heat flux  $31\text{ kW.m}^{-2}$ ,  $44\text{ kW.m}^{-2}$  and  $53\text{ kW.m}^{-2}$  were conducted seven measurements for determining the time to flaming ignition of OSB samples by thickness of 8 mm, 14 mm and 25 mm. The distance from the surface of the electrically heated radiator to the specimen surface was constant 50 mm. It was found that when heat flux  $31\text{ kW.m}^{-2}$  is applied to the samples surfaces, there is no flame combustion within less than 10 minutes. With such mode, the thermal load generates on the surfaces enriched carbon layer. Also, when using OSB samples with a thickness of 8 mm, 14 mm and 25 mm, heat flux was insufficient to ignite the samples and there was observed only process of smouldering. On the surface, a continuous carbon layer was formed (Figure 4).



**Fig. 4** OSB samples exposed to a heat flux of  $31\text{ kW.m}^{-2}$  for 10 min. (from the left the thickness of specimen: 8 mm, 14 mm, 25 mm)

In the following experiment, we increased the intensity of the heat flux to  $44 \text{ kW.m}^{-2}$ . All samples at heat flux  $44 \text{ kW.m}^{-2}$  were ignited and flame combustion occurred during experiments. Average time to ignition for 8 mm thick sample was 69 seconds, for 14 mm thick sample the time to ignition dropped to 56 seconds. Figure 5 show the burning mode for the selected heat flux  $44 \text{ kW.m}^{-2}$ . Using the heat flux of  $44 \text{ kW.m}^{-2}$  the sample of 25 mm thickness has the time to self-ignition 61 seconds. The OSB samples exhibit a strong surface degradation with formation of a carbon layer on the surface. In the first stage, the degradation is caused by the flame combustion, while in the second phase by decomposition during flameless combustion (Figure 5 - 6).

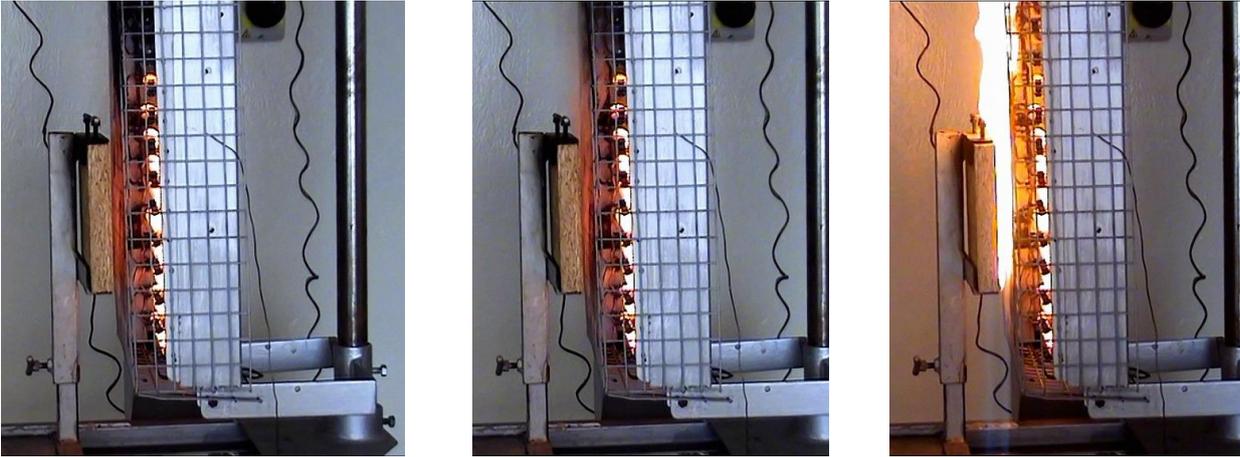


**Fig. 5** Ignitability experiment of 25 mm thick OSB board under  $44 \text{ kW.m}^{-2}$  heat flux



**Fig. 6** OSB samples exposed to a heat flux of  $44 \text{ kW.m}^{-2}$  for 10 min.  
(from the left: 8 mm, 14 mm, 25 mm)

At the heat flux  $53 \text{ kW.m}^{-2}$  during the experiment, each sample was self-ignited. Figures 7 - 8 show the burning mode for the selected heat flux of  $53 \text{ kW.m}^{-2}$ .

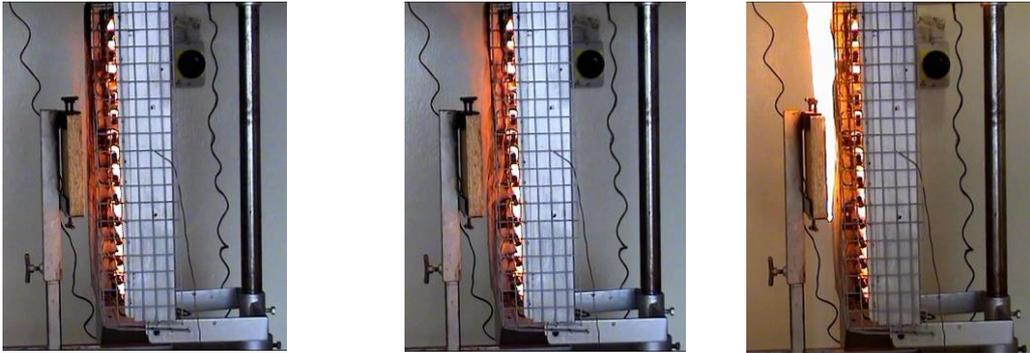


**Fig. 7** Ignitability experiment of 25 mm thick OSB board under  $53 \text{ kW.m}^{-2}$  heat flux

Average time to self-ignition of 8 mm OSB board at heat flux  $53 \text{ kW.m}^{-2}$  was 61 s. Big difference (13 seconds) was even measured between the 14 mm and 25 mm samples. We can assume that the samples thickness has a significant influence on the time to self-ignition. Figure 10 shows the OSB board samples (thickness of 8 mm, 14 mm, and 25 mm) exposed to the heat flux of  $53 \text{ kW.m}^{-2}$  until flame combustion was on.



*Fig. 8 OSB samples exposed to a heat flux of  $53 \text{ kW.m}^{-2}$  for 10 min. (from the left: 8 mm, 14 mm, 25 mm)*

In conclusion, we can say that the time to ignition and fire behaviour of samples are influenced by their thickness; however, the value of the heat flux is crucial (Figure 9). The three stages of combustion process, pyrolysis, burning and char oxidation, are closely interrelated.

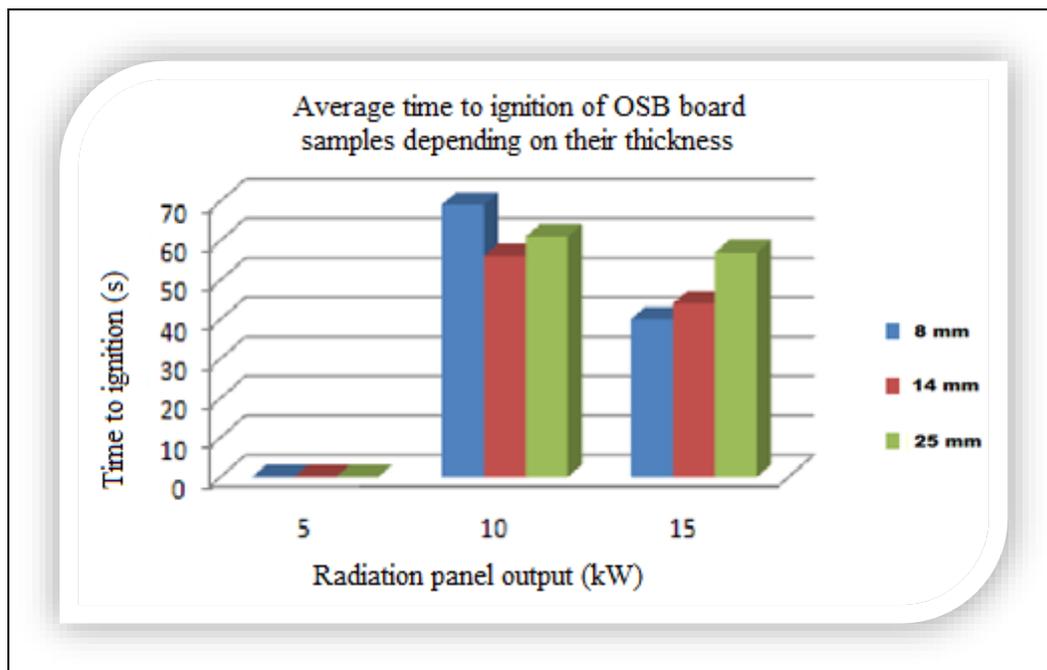

*Fig. 9 Average time to ignition of the OSB board samples depending on their thickness*

## CONCLUSION

The studies clearly indicate that the time of self-ignition of the OSB specimens strongly depends on the heat flux density and the orientation of the sample. Results achieved using the VERP methods are very useful in the fire hazard analysis. Therefore, further research on the ignition parameter, the type of radiator, the presence of the pilot flame, and the time of thermal load would be a useful continuation for clarifying the burning process in the initiation phase of fire.

## Acknowledgements

This paper was supported by the Slovak Research and Development Agency under the contract No. APVV-0057-12.

## References:

1. KAČÍKOVÁ, D. 2012. Alterations of selected characteristics of oak and poplar wood after thermal loading by radiation sources. In: *Wood and Fire Safety: 7th Scientific International Conference*, pp. 107-110. ISBN 978-80-87427-23-1
2. DRYSDALE, D. An Introduction to Fire Dynamics. 1990. John Wiley and Sons, A Wiley – Interscience Publication, pp. 253-277. ISBN: 0-471-90613-1
3. KOŠÍK, M. 1986. *Polymérne materiály a ich požiarna ochrana. (Polymeric materials and their fire protection.)* Bratislava: ALFA, 90 p.
4. BABRAUSKAS, V. 2003. *Ignition Handbook. Chapter 7. Ignition of common solids.* London: Fire Science Publishers and Society of Fire Protection Engineers, pp. 234-339. ISBN 0-9728111-3-3
5. Di NENNO, P. et al. 1995. *The SFPE Handbook of Fire Protection Engineering. Fire Dynamics.* Quincy: National Fire Protection Association, 227 pp. ISBN 0-87765-354-2
6. TROITZSCH, J. 1990. *Plastics Flammability Handbook: Principles, Regulationos and Approval.* Munchen/Wien: Carl Hanser Verlag 517 pp. N.Y. ISBN: 3-446-15156-7
7. ISO 9705:1993. Fire Tests. Full Scale Room Test for Surface Products.
8. BABRAUSKAS, V. 1992. From Bunsen Burner to Heat Release Rate Calorimeter. In: *Heat Release in Fires: Chapter 2.* London and New York: Elsevier Applied Science, pp 7-29. ISBN 1-85166-794-6
9. BABRAUSKAS, V., PEACOCK, R. D. Heat Release Rate: The Single most important variable in Fire Hazard. *Fire Safety Journal*, **18**(3), pp. 255-272.
10. ISO/DIS 14934-4. 2013. *Fire tests – Calibration and use of heat flux meters- Part 4 Guidance on the use of heat flux meter in fire tests.* 24 p.
11. HUGGETT, C. 1980. Estimation of the Rate of Heat Release by Means of Oxygen Consumption. *Journal of Fire and Flammability*, Vol. 12, pp. 61-65.
12. BABRAUSKAS, V. 1982. *Development of the Cone Calorimeter – A Bench-scale Rate of Heat Release Apparatus Based on Oxygen Consumption.* NBSIR 82-2611. NBS. Gaithersburg, MD.
13. Kronospan OSB Superfinish ECO - OSB for interior use as a load-bearing building element in a damp environment. OSB / 3 according to EN 300, carrier plate for use in humid environments. Kronospan, s.r.o., Jihlava. Statement of features number OSB3-CPR-2013-07-01.
14. ISO 11358-1:2014: Plastics - Thermogravimetry (TG) of polymers -- Part 1: General principles.
15. ISO 11357-1:2016: Plastics - Differential scanning calorimetry (DSC) - Part 1: General principles.
16. BABRAUSKAS, V., GRAYSON, S. J. 1992. *Heat Release in Fires.* Elsevier Science Publisher LTD, 644 p.

## ORCID:

Karol Balog 0000-0002-0804-8338